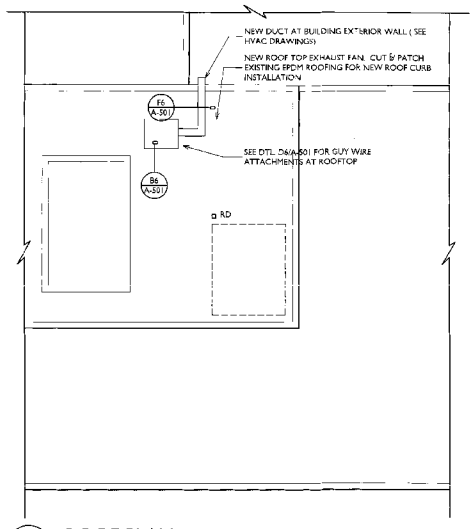

E1 ROOF PLAN
SCALE: 1/8" = 1'-0"

FINISH SCHEDULE

GENERAL NOTES:

1. CHANGES IN FLOOR FINISH OCCUR AT CENTERLINE OF DOOR; UNLESS NOTED OTHERWISE.
2. VCT TO BE 12" X 12" ARMSTRONG STANDARD EXCELON IMPERIAL TEXTURE (1/8" THICK) OR APPROVED EQUAL. APPLY 2 COATS OF SEALER IN ALL ROOMS WITH VCT WITHIN WORK AREA. USE LOW VOC, WATER RESISTANT ADHESIVE COMPATIBLE WITH SUBSTRATES.
3. VINYL BASE TO BE 6" COVE BASE (1/8" THICK) ROPPE OR APPROVED EQUAL. USE LOW VOC, WATER RESISTANT ADHESIVE COMPATIBLE WITH SUBSTRATES.
4. SUSPENDED TILE CEILINGS (SAT.) TO HAVE 2' X 2' CEILING PANELS SUPPORTED BY A 15/16" GRID SYSTEM. TILE TO BE ARMSTRONG 2909 'RANDOM FISSURED', SQUARE EDGE WITH ARMSTRONG PRELUDE GRID OR APPROVED EQUAL.
5. PAINT ALL EXISTING DOOR FRAMES FACING NEW WORK AREAS OR SCHEDULE TO RECEIVE NEW DOOR HARDWARE.
6. AT CORRIDOR, PAINT EXISTING WALLS TO 3 PEEY BEYOND ALL DISTURBED WALL AREAS, NEW DOORS AND UTILITY PENETRATIONS.
7. REFURBISH ALL EXISTING DOORS FACING NEW WORK AREAS OR AT BOTH SIDES IF DOOR IS TO RECEIVE NEW HARDWARE.

FINISH ABBREVIATIONS:

WOM = WALK-OFF MAT
ETR = EXISTING TO REMAIN
VCT = VINYL TILE
VB = VINYL BASE
PNT = PAINT
CT = CERAMI TILE
SAT = SUSPENDED ACOUSTICAL TILE
SV = SHEET VINYL
ECSD = EXPOSED CONCRETE STRUCTURAL DECK
VAT = VINYL ASBESTOS TILE
C & P = CUT AND PATCH

ROOM NO.	ROOM NAME	FLOOR	BASE	WALL	CEILING	COMMENTS
299N	PUBLIC CORRIDOR	C & P / VAT	C & P / VB	PNT	ETR / SAT	C & P FINISHES AS REQUIRE FOR NEW CONSTRUCTION
N224	CONFERANCE	ETR	C & P	PNT	ETR / SAT	C & P CEILING TO ACCOMMODATE NEW WALL
N224A	OFFICE	ETR	ETR	ETR	ETR / SAT	
N224B	BOX STORAGE	ETR-VAT	VB	PNT	SATI	
N243	LAB SUPPLIES	ETR	ETR	ET	ETR	
N245	LAB	VCT	VB	PNT	SATI	
N247	LAB MGR. OFFICE	VCT	VB	PNT	SATI	
N247A	FUME HOOD	VCT	VB	PNT	SATI	
N249	SECURE EVID.	VCT	VB	PNT	SATI	
N251	RECEPTION WAITING	VCT	VB	PNT	SATI	
N251A	EVIDENCE OFFICE	VCT	VB	PNT	SATI	
N251B	TANK STOR.	VCT	VB	PNT	SATI	
N253A	STORAGE	ETR	ETR	ETR	ECSD/PNT	PATCH WALL PNT AT UTILITY PENETRATIONS
N299T	TANK RECIEVING	ETR	ETR	ETR	ECSD/PNT	PATCH WALL PNT AT UTILITY PENETRATIONS

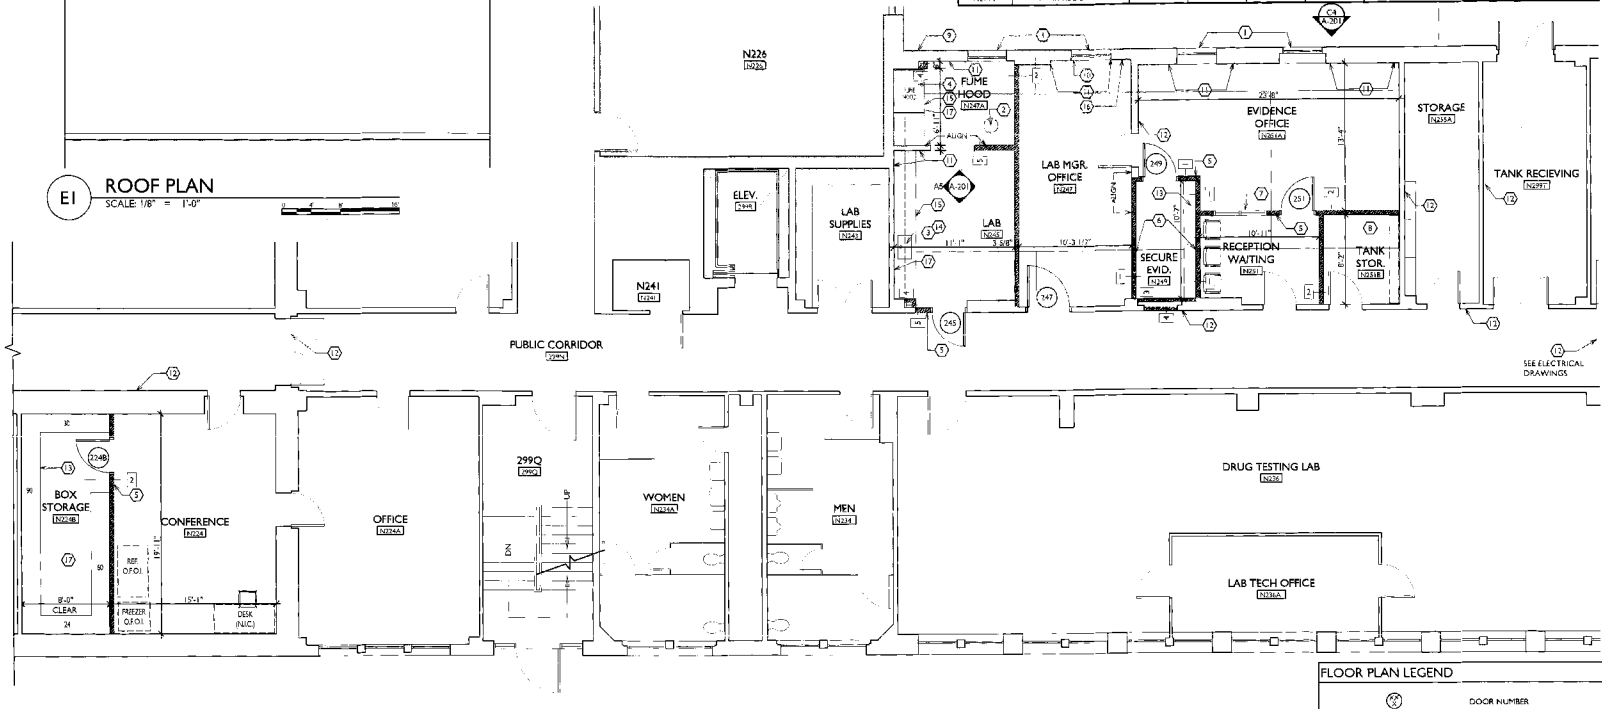

B1 PARTIAL SECOND FLOOR PLAN
SCALE: 3/16" = 1'-0"

FLOOR PLAN LEGEND

- DOOR NUMBER
- WINDOW NUMBER
- WALL TYPE
- PARTITIONS/INFILL
- EXISTING TO REMAIN
- INTERIOR ELEVATION MARKER

GENERAL SHEET NOTES

1. THIS PROJECT WILL BE CONSTRUCTED IN PHASES TO ALLOW CONTINUOUS OCCUPANCY FOR THE DPH STAFF. PHASE 1 WILL INCLUDE ALL RENOVATIONS REQUIRED AT N224 AND N224A. THE CONSTRUCTION OF THE STORAGE ROOM N224B WILL INCLUDE A TEMPORARY CARD ACCESS READER WIRED TO LOCKING DOOR HARDWARE. THE STORAGE ROOM WILL BE USED AS A TEMPORARY SECURE STORAGE SPACE FOR EVIDENCE KEPT ONSITE. UPON COMPLETION OF THE CONSTRUCTION IN N224, N224A AND N224B, PHASE 2 CONSTRUCTION WORK WILL START. PHASE 2 WILL INCLUDE THE WORK REQUIRED IN ROOMS 243 THRU 251B.
2. CUT & PATCH EXISTING PLASTER WALL FINISH AT ALL LOCATIONS WHERE NEW WALLS ABUT EXISTING WALLS. AT NEW CMU WALL LOCATIONS, REMOVE EXISTING PLASTER FROM FACE OF EXISTING CMU OR CONCRETE WALLS/COLUMNS TO REMAIN TO ALLOW FOR A SOLID TIE-IN TO EXISTING CONSTRUCTION.
3. AT ALL NEW VCT FLOORING AREAS, CONTRACTOR TO INSTALL K-15 SELF-LEVELING UNDERLAYMENT CONCRETE BY ARDEX, INC. OR APPROVED EQUAL. PREP SLAB PER LEVELING COMPOUND MANFACTURER RECOMMENDATIONS.
4. ALL WOOD BLOCKING REQUIRED IN NEW WALLS TO BE FIRE-TREATED.
5. PROVIDE FIRESTOPPING AT ALL NEW AND EXISTING ABANDONED FLOOR & WALL PENETRATIONS. SEE HVAC, PLUMBING & ELECTRICAL DRAWINGS FOR FIRESTOPPING LOCATIONS. SUBMIT UL DESIGNS FOR EACH PENETRATION TYPE & INSTALL NEW FIRESTOPPING TO MEET UL DESIGN REQUIREMENTS. PROVIDE PAINTABLE FIRESTOPPING WHERE PENETRATION IS TO REMAIN EXPOSED. INFILL LARGE OPENINGS WHERE HVAC DUCTS ARE REMOVED TO MATCH EXISTING WALL CONSTRUCTION. SEE HVAC DRAWINGS FOR LOCATIONS.
6. PROVIDE FIRE SEALANT AT ALL NEW JOINTS WHERE FIRE RATED JOINTS ARE REQUIRED. SUBMIT UL DESIGNS FOR EACH JOINT TYPE & INSTALL NEW FIRE SEALANT TO MEET UL DESIGN REQUIREMENTS. PROVIDE PAINTABLE FIRE SEALANT WHERE PENETRATION IS TO REMAIN EXPOSED.
7. INSTALL NEW JOINT SEALANT AT ALL LOCATIONS WHERE DISSIMILAR MATERIALS MEET. INSTALL JOINT SEALANT COMPATIBLE & RECOMMENDED FOR USE WITH ADJOINING MATERIALS.

SHEET KEYNOTES

1. NEW 38" x 38" (V.I.F.) SECURITY SCREENS AT EXTERIOR WINDOWS. SLIMLINE SECURITY SCREEN (SECURITY LEVEL 3) W/ 12 GA. MESH SCREEN BY AVANTGARD MANUFACTURING OR APPROVED EQUAL.
2. NEW ADA EMERGENCY SHOWER.
3. NEW METAL BASE CABINETS WITH PHENOLIC COUNTERTOP & STAINLESS STEEL SINK. EMERGENCY EYEWASH STATION ADJACENT TO SINK WITH TEMPERED WATER.
4. NEW 4' WIDE METAL LOW FLOW FUME HOOD WITH GLASS DOORS. DUCTED EXHAUST TO PENETRATE BUILDING EXTERIOR WALL WITH DAMPER. DUCT UP TO ROOFTOP-MOUNTED EXHAUST FAN. UTILITIES AT FUME HOOD ARE ELECTRICAL OUTLETS ONLY.
5. NEW CARD ACCESS READER AT DOOR.
6. NEW 4" CMU WALL CONSTRUCTION AT NEW EVIDENCE STORAGE ROOM WALLS.
7. NEW 5' WIDE X 3' TALL TEMPERED GLASS WINDOW WITH HOLLOW METAL FRAME.
8. RELOCATED MEDICAL GAS STORAGE TANKS. CUT AND PATCH WALL FOR NEW FIRE TREATED WOOD BLOCKING AS REQUIRED FOR MOUNTING ANCHORDS.
9. CUT AND PATCH EXISTING BRICK EXTERIOR WALL AS REQUIRED FOR NEW FUME HOOD EXHAUST DUCT. CUT AND PATCH PLASTER AT INTERIOR FACE OF WALL.
10. REMOVE EXISTING WOOD CASING AS REQUIRED TO REPLACE EXISTING WOOD WINDOW WITH NEW ALUMINUM INSULATED WINDOW. REINSTALL CASING AND PAINT. ALUMINUM WINDOW TO BE EFCO SERIES 4701 OR EQUAL.
11. SCRAPE AND PAINT WALL AT PEELING PAINT LOCATIONS (SEE HAZARDOUS MATERIAL SPEC'S FOR PREPARATION REQUIREMENTS).
12. CUT & PATCH EXISTING WALL FOR NEW UTILITY LINE PENETRATION. PATCH WALL & SEAL AS REQUIRED FOR WALL FIRE RATING & CONSTRUCTION. USE PAINTABLE FIRE SEALANT MATERIAL FOR PENETRATION LOCATIONS EXPOSED TO VIEW.
13. NEW SHELVING - BY OWNER.
14. CUT & PATCH EXISTING PLASTER WALL CONSTRUCTION FOR PLUMBING WORK AT NEW SINK LOCATION. INFILL WALL OPENING WITH NEW METAL STUDS & GYPSUM BOARD WITH THICKNESS TO MATCH EXISTING PLASTER.
15. INSTALL METAL CABINETS WITH ADJUSTABLE FEET & ADJUSTABLE TOEKICK PLATES. PROVIDE 6" VINYL BASE AT METAL CABINET TOEKICK AND SIDE PANELS.
16. REMOVE EXISTING DAMAGED PLASTER AT EXTERIOR WALL (APPROX. 10 SF) DOWN TO MASONRY SUBSTRATE. IN-FILL WITH 1/2" GAVI METAL RESILIENT 'Z' CHANNELS AT 16" O.C. & ½" GYPSUM BOARD. ADJUST GYPSUM BOARD THICKNESS AS REQUIRED TO MATCH EX. PLASTER THICKNESS.
17. CUT & PATCH EXISTING METAL STUD WITH PLASTER WALLS AS REQUIRED FOR NEW WALL MOUNTED BASE CABINETS, WALL CABINETS, FUMEHOOD & ADJUSTABLE SHELVING STANDARDS. PATCH WALLS WITH NEW GYPSUM BOARD & DRYWALL COMPOUND TO MATCH PLASTER THICKNESS.

REV. NO	DESCRIPTION	BY	APP'D	DATE
	BID DOCUMENTS	KS		5/28/10
	100% DD ESTIMATE SET	KS		5/27/10
	100% DESIGN DEVELOPMENT SET	KS		5/13/10
	SCHEMATIC DESIGN SUBMISSION	KS		4/1/10

UMASS
UNIVERSITY OF MASSACHUSETTS
FACILITIES PLANNING DIVISION

RENOVATION FOR WESTERN MASS DPH OFFICE
MORRILL SCIENCE CENTER
PARTIAL SECOND FLOOR PLAN

	BY	DATE
DRN		
APP'D		
CHK		
APP'D		

PROJECT NO. D-09-001234-01
CONTRACT NO. UMMD-862
SCALE: AS NOTED
SHEET: 4 OF 24
DRAWING NUMBER: D-A-09-001234-01- **A-120**

Folk_OIG_PRR_095664